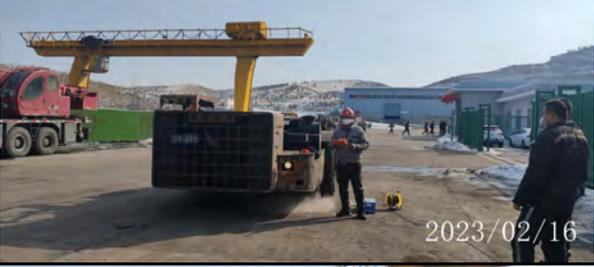


序号	报告编号	发布日期	结论	影像资料
1	GX-B1314/21-7-23019~23022	2023. 4. 3	本次共检验煤矿在用干式电抗器4台，4台煤矿在用干式电抗器所检项目合格。	
2	GX-B1495/20-7-23158~23172	2023. 4. 4	本次共检高压开关柜15台，15台高压开关设备所检项目合格。	
3	GX-B1307/20-7-23001	2023-4-4	综合判定：合格。	
4	GX-B1307/20-7-23002	2023-4-4	综合判定：合格。	

5	GX-B1307/20-7-23003	2023-4-4	综合判定：合格。	
6	GX-B1307/20-7-23004	2023-4-4	综合判定：合格。	
7	GX-B1417/22-7-23038	2023-4-4	综合判定：合格。	
8	GX-B1417/22-7-23039	2023-4-4	综合判定：合格。	

9	GX-B1417/22-7-23040	2023-4-4	综合判定：合格。	
10	GX-B1417/22-7-23041	2023-4-4	综合判定：合格。	
11	GX-B1417/22-7-23042	2023-4-4	综合判定：合格。	
12	GX-B1417/22-7-23043	2023-4-4	综合判定：合格。	

13	GX-B1417/22-7-23044	2023-4-4	综合判定：合格。	
14	GX-B1417/22-7-23045	2023-4-4	综合判定：合格。	
15	GX-B1417/22-7-23046	2023-4-4	综合判定：合格。	
16	GX-B1417/22-7-23047	2023-4-4	综合判定：合格。	

17	GX-B1417/22-7-23048	2023-4-4	综合判定：合格。	
18	GX-B1417/22-7-23049	2023-4-4	综合判定：合格。	
19	GX-B1417/22-7-23050	2023-4-4	综合判定：合格。	
20	GX-B1417/22-7-23051	2023-4-4	综合判定：合格。	

21	GX-B1417/22-7-23052	2023-4-4	综合判定：合格。	
22	GX-B1417/22-7-23053	2023-4-4	综合判定：合格。	
23	GX-B1417/22-7-23054	2023-4-4	综合判定：合格。	
24	GX-B1417/22-7-23055	2023-4-4	综合判定：合格。	

25	GX-B1559/22-7-23018	2023-4-4	所检项目合格。	
26	GX-B1321/20-7-23021~23029	2023. 4. 6	本次共检电力电缆9条，9条电力电缆所检项目合格。	
27	GX-B1321/20-7-23030~23039	2023. 4. 6	本次共检电力电缆10条，10条电力电缆所检项目合格。	
28	GX-B1321/20-7-23040~23045	2023. 4. 6	本次共检电力电缆6条，6条电力电缆所检项目合格。	

29	GX-B1321/20-7-23046~23054	2023. 4. 6	本次共检电力电缆9条，9条电力电缆所检项目合格。	
30	GX-B1321/20-7-23055~23064	2023. 4. 6	本次共检电力电缆10条，10条电力电缆所检项目合格。	
31	GX-B1312/20-7-23035~23038	2023. 4. 6	本次共检电力变压器4台，4台电力变压器所检项目合格。 。	
32	GX-B1312/20-7-23039~23042	2023. 4. 6	本次共检电力变压器4台，4台电力变压器所检项目合格。 。	

33	GX-B1312/20-7-23043~23052	2023. 4. 6	本次共检电力变压器10台，10台电力变压器所检项目合格。	
34	GX-B1312/20-7-23053~23064	2023. 4. 6	本次共检电力变压器12台，12台电力变压器所检项目合格。	
35	GX-B1312/20-7-23065~23066	2023. 4. 6	本次共检电力变压器2台，2台电力变压器所检项目合格。	
36	GX-B1312/20-7-23111~23118	2023. 4. 6	本次共检电力变压器8台，8台电力变压器所检项目合格。	

37	GX-B1321/20-7-23119~23125	2023. 4. 6	本次共检电力电缆7条，7条电力电缆所检项目合格。			
38	GX-B1495/20-7-23285~23300	2023. 4. 6	本次共检高压防爆开关16台，16台高压防爆开关所检项目合格。			
39	GX-B1310/21-7-23046	2023. 4. 6	未发现超过Φ3mm当量直径缺陷			
40	GX-B1428/21-7-23046	2023. 4. 6	无缺陷痕迹显示			

41	GX-B1310/21-7-23047	2023. 4. 6	未发现超过 Φ 3mm当量直径缺陷		
42	GX-B1428/21-7-23047	2023. 4. 6	无缺陷痕迹显示		
43	GX-B1310/21-7-23048	2023. 4. 6	符合标准要求		
44	GX-B1310/21-7-23049	2023. 4. 6	未发现超过 Φ 3mm当量直径缺陷		

45	GX-B1310/21-7-23050	2023. 4. 6	未发现超过 $\Phi 3\text{mm}$ 当量直径缺陷	
46	GX-B1310/21-7-23051	2023. 4. 6	未发现超过 $\Phi 3\text{mm}$ 当量直径缺陷	
47	GX-B1424/20-7-23004	2023. 4. 6	依据NB/T 10176-2019单轨吊车综合判定合格。	
48	GX-B1424/20-7-23005	2023. 4. 6	依据NB/T 10176-2019单轨吊车综合判定合格。	

49	GX-B1354/20-7-23004	2023-4-7	电网接地电容电流符合规定	
50	GX-B1354/20-7-23005	2023-4-7	电网接地电容电流符合规定	
51	GX-B1495/20-7-23158~23172	2023. 4. 4	本次共检高压开关柜15台，15台高压开关设备所检项目合格。	
52	GX-B1404/20-7-23010	2023-4-7	所检电网谐波电压总谐波畸变率、各次谐波电压含有率、谐波电流符合 GB/T 14549-1993 《电能质量 公用电网谐波》要求。	

53	GX-B1404/20-7-23011	2023-4-7	所检电网谐波电压总谐波畸变率、各次谐波电压含有率、谐波电流符合 GB/T 14549-1993 《电能质量 公用电网谐波》要求。			
54	GX-B1404/20-7-23012	2023-4-7	所检电网谐波电压总谐波畸变率、各次谐波电压含有率、谐波电流符合 GB/T 14549-1993 《电能质量 公用电网谐波》要求。			
55	GX-B1404/20-7-23013	2023-4-7	所检电网谐波电压总谐波畸变率、各次谐波电压含有率、谐波电流符合 GB/T 14549-1993 《电能质量 公用电网谐波》要求。			





